

Matlab Design and Simulation of AGC and AVR for Single Area Power System with Fuzzy Logic Control

Parveen Dabur, Naresh Kumar Yadav, Ram Avtar

Abstract— This paper deals with the combination of automatic generation control (AGC) of thermal system with automatic voltage control (AVR). In this particular work thermal unit is considered with single area concept. The primary purpose of the AGC is to balance the total system generation against system load and losses. Any mismatch between generation and demand causes the system frequency to deviate from scheduled value. Thus high frequency deviation may lead to system collapse. Further the role of automatic voltage regulator is to hold terminal voltage magnitude of synchronous generator at a specified level. The interaction between frequency deviation and voltage deviation is analyzed in this paper. System performance has been evaluated at various loading disturbances. This paper describes the design, implementation and operation performance of fuzzy controller as part of the combined loop of AGC & AVR for single area power system. The fuzzy controller is implemented in the control of ACE calculation in the case of AGC & excitation in case of AVR, which determines the shortfall or surplus generation that has to be corrected. In the case of AVR, fuzzy with PID has been implemented.

Index Terms— Automatic Generation Control (AGC), Automatic Voltage Regulator (AVR), Area Control Error (ACE), Frequency Response, Voltage Response, Governor Action, Power System Operation, Fuzzy logic, Fuzzy control.

I. INTRODUCTION

Automatic Generation Control (AGC), is very important issue in power system operation and control for supplying sufficient and both good quality and reliable electric power [1]. Investigations have shown [3] that following a sudden load change or disturbances in a single area power system, the frequency undergoes a fluctuation which persists for a very long time. This fluctuation is very poorly damped. Since these oscillations are the result of imbalance of power [3, 4]. The generation is adjusted automatically by Automatic Generation Control to restore the frequency to the nominal value as the system load changes continuously [5].

The generator excitation system maintains generator voltage and controls the reactive power flow. The generator excitation of older system may be provided through slip rings and brushes by means of DC generators mounted on the same shaft as the rotor of the synchronous machine. A change in the real power demand affects essentially the frequency, whereas

a change in the reactive power affects mainly the voltage magnitude. The interaction between voltage and frequency controls is generally weak enough to justify their analysis separately. The sources of reactive power are generators, capacitors, and reactors. The generator reactive powers are controlled by field excitation. Other supplementary method of improving the voltage profile in the electric transmission systems are transformer load tap changers, switched capacitors, step voltage regulators and static Var control equipment. The primary means of generator reactive power control is the generator excitation control using automatic voltage regulator (AVR). The role of an AVR is to hold the terminal voltage magnitude of synchronous generator at a specified level [7].

The proportional integral (PI) control approach is successful in achieving zero steady-state error in the frequency of the system, but exhibits relatively poor dynamic performance as evident by large overshoot and transient frequency oscillations. Moreover, the transient settling time is relatively large [9]. Fixed integral gain controllers have been proposed for nominal operating conditions but they fail to provide best control performance over a wide range off-nominal operating conditions. In this paper, the fuzzy logic is effectively used to change the integral gain, K_i of AGC settings automatically to restore nominal system frequency for various wide-range off-nominal power system parameters and load changes [12]. An increase in the reactive power load of the generator is accompanied by a drop in the terminal voltage magnitude. The voltage magnitude is sensed through a potential transformer on one phase. This voltage is rectified and compared to DC set point signal. The amplified error signal controls the exciter field and increases the exciter terminal voltage. Thus, the generator field current is increased, which result in an increase in the generated emf. The reactive power generation is increased to a new equilibrium, raising the terminal voltage to the desired value. This paper presents a development of voltage control of AVR or excitation system by using a self-tuning fuzzy PID controller to overcome the appearance of nonlinearities and uncertainties in the systems [10]. The self-tuning fuzzy PID controller is the combination of a classical PID and fuzzy controller. A typical single area combined loop of AGC and AVR power system is considered as a test network and simulation results are presented and discussed.

Manuscript received October 09, 2011.

Parveen Dabur, Electrical Engg., Hindu college of Engg., Sonipat, India, 09812167269, (e-mail: parveen.eng11@gmail.com).

Naresh Kumar Yadav, Electrical Engg., D.C.RU.S.T, Murthal, Sonipat, India, 09466176565, (e-mail: nkyadav76@gmail.com).

Ram Avtar, WIMAX & CDMA, BSNL, Sonipat, India, 09416450900, (e-mail: ram_ahlawat@rediffmail.com).

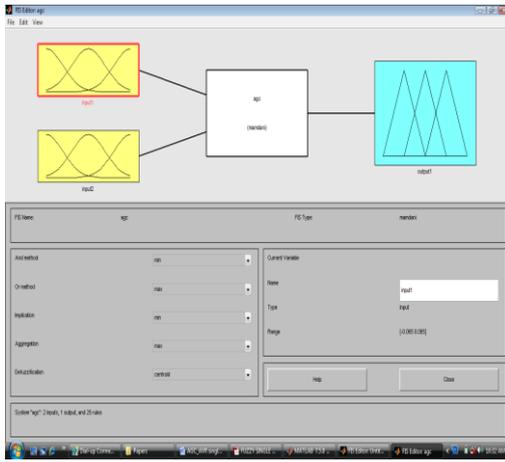


Fig 3: Fuzzy inference block

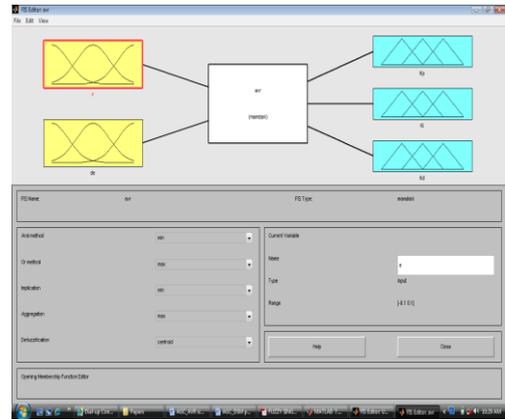


Fig 8: Fuzzy inference block

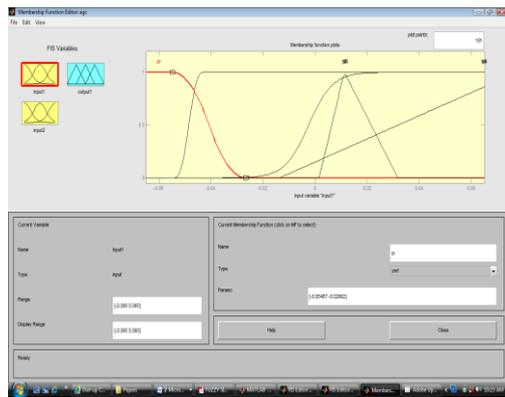


Fig 4: Membership functions of e(t)

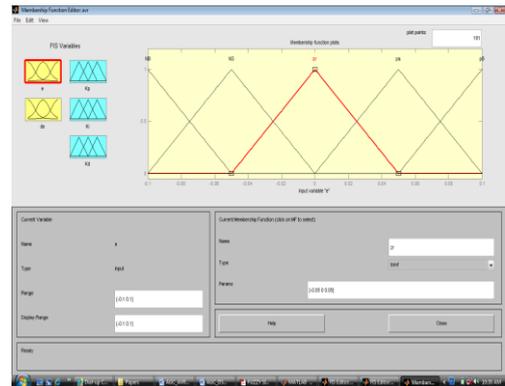


Fig 9: Membership functions of e(t)

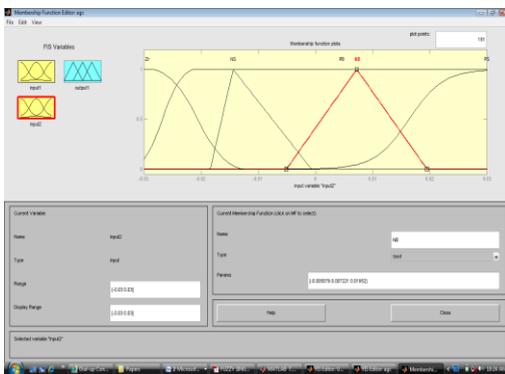


Fig 5: Membership functions of de(t)

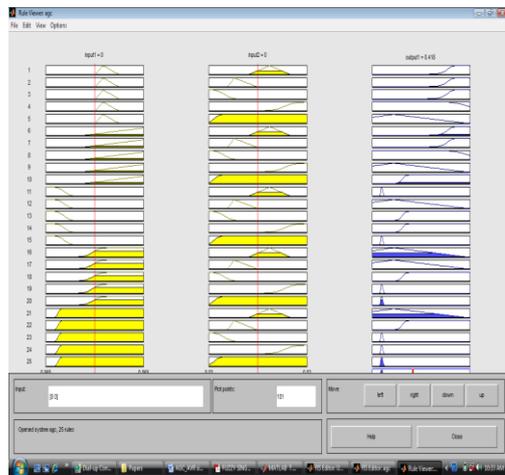


Fig 7: Fuzzy rules viewer

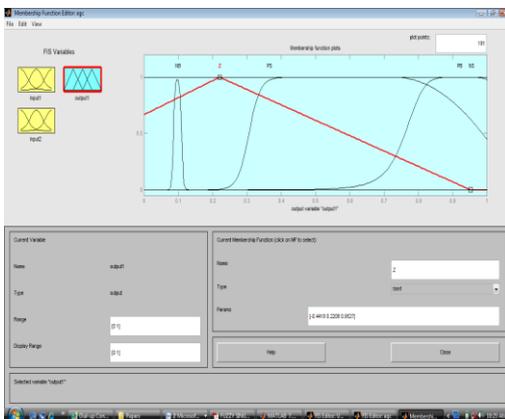


Fig 6: The output membership function

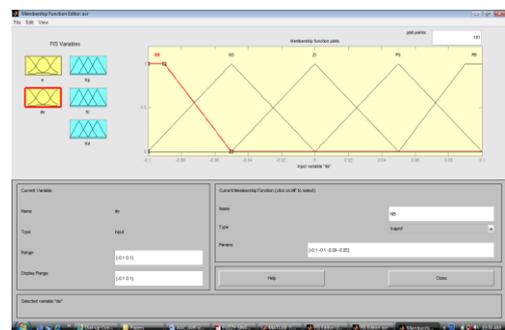


Fig 10: Membership functions of de(t)

D. Membership Functions For AVR For The Fuzzy Variables Of The Proposed FLC

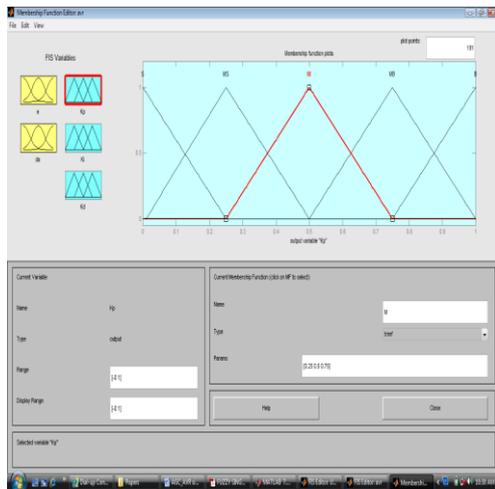


Fig 11. Membership functions of Kp, Ki and Kd.

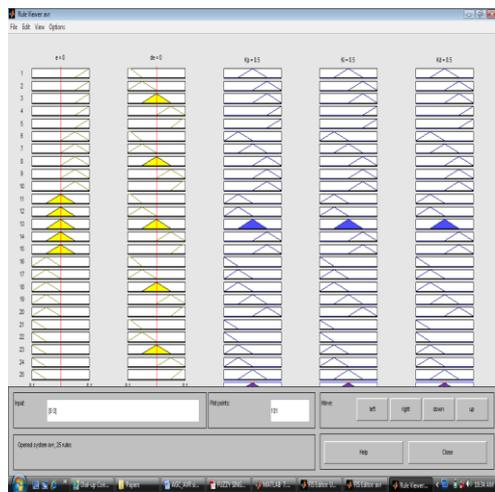


Fig 12: Fuzzy rules viewer

Though it is possible to derive a membership value for this variable in many possible ways, one of the rules that has been chosen is

$$\mu(e_t, c, \dot{e}_t) = \min [\mu(e_t), \mu(c, \dot{e}_t)] \quad (6)$$

The fuzzy rule bases are constructed by using trial and error methods.

E. Defuzzification

The well-known center of gravity defuzzification method has been used because of its simplicity:

$$K_I = \frac{\sum_{j=1}^{n_i} \mu_j u_j}{\sum_{j=1}^{n_i} \mu_j} \quad (7)$$

Where, μ_j , is the membership value of the linguistic variable recommending the fuzzy controller action, and u_j is the precise numerical value corresponding to that fuzzy controller action. The membership functions, knowledge base and method of defuzzification essentially determine the controller performance [13].

IV. SIMULATION RESULTS AND PERFORMANCES

The simulation results of the studies are depicted in fig 13, 14, 15 & 16. Fig 13 shows the AGC and AVR frequency response for single Area without fuzzy controller. Here the frequency oscillations are controlled near about 35 seconds. With the addition of proposed schemes, the damping is improved significantly. Fig 14 shows the AGC and AVR frequency response for Single Area with fuzzy control, here the frequency oscillation has been controlled near about 10 seconds. Fig 15 shows the AGC and AVR voltage response for single Area without fuzzy controller. Here the voltage oscillations are controlled near about 2.5 seconds. With the addition of proposed schemes, the damping is improved significantly. Fig 16 shows the AGC and AVR voltage response for Single Area with fuzzy control here the voltage has been controlled in 2 seconds.

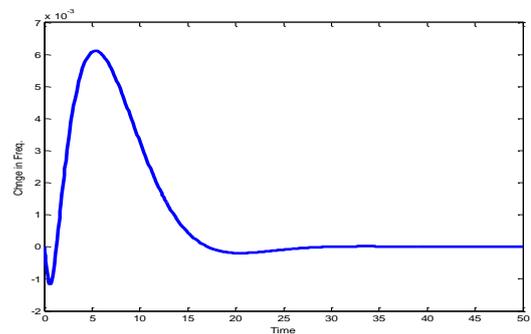


Fig 13: AGC and AVR frequency response for single Area without fuzzy controller

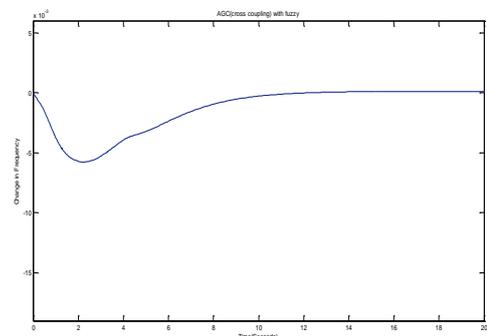


Fig 14: AGC and AVR frequency response For Single Area with fuzzy controller

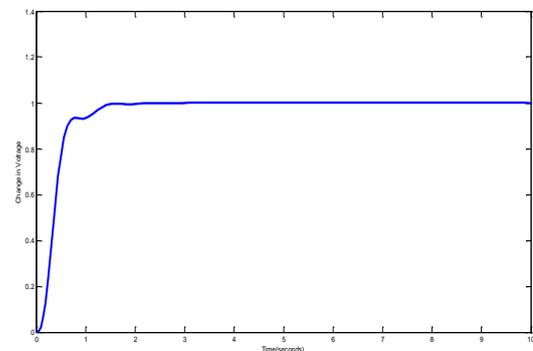


Fig 15: AGC and AVR voltage response for Single Area without fuzzy controller

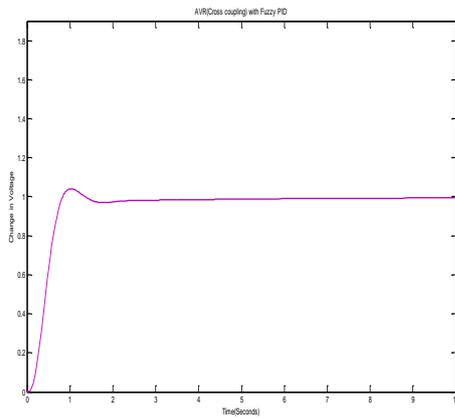


Fig 16 AGC and AVR voltage response for single Area with fuzzy controller

V. CONCLUSION

The fuzzy gain scheduling of AGC in a single area power system has been implemented. The fuzzy logic approach to integral gain scheduling yields overall better performance regarding transient responses in comparison to the case of fixed integral gain. The settling time is reduced to a great extent with the proposed mode of scheduling. The gain scheduling approach yields automatic, self-adjusting outputs irrespective of widely varying, imprecise, uncertain off-nominal conditions. The memory and the computational burden have been reduced and also settling time reduces drastically in the fuzzy logic approach scheme.

I: ASSUMPTIONS USED IN THE SIMULATION RUNS FOR AGC

Quantity	Area-I
Governor speed regulation	$R_1 = 0.051$
Frequency bias factors	$D_1 = 0.62$
Inertia constant	$H_1 = 5$
Base power	1000MVA
Governor time constant	$T_{sg1} = 0.2$ sec
Turbine time constant	$T_{t1} = 0.5$ sec
Constant	$k = 1/2\pi = 0.159$
Nominal frequency	$f_1 = 50$ Hz
Load change	$\Delta P_{L1} = 180.2$ MW
Load disturbance in per unit	$(\Delta P_{L1})_{p.u} = 0.1802$

ASSUMPTIONS USED IN THE SIMULATION RUNS FOR AVR

Quantity	Gain	Time Constant
Amplifier	9	0.1
Exciter	1	0.4
Generator	1	1.0
Sensor	1	0.05

Quantity	Gain
PID Controller	$K_p = 1.0$ $K_i = 0.25$ $K_d = 0.28$

ACRONYMS

- B : Frequency Bias factor
- D : Percent change in load divided by the percent change in frequency
- Ki : Supplementary control constant
- H : Inertia Constant
- ΔP : Change in power
- ΔP_{Mech} : Change in mechanical power input
- ΔP_D : Change in power demanded by the load in an area
- $\Delta P_{Tie-flow}$: Change in power transmitted over tie line
- ΔP_{Valve} : Change in valve position from nominal
- R : Speed Droop Characteristic
- T_{Ps} : Power system time constant
- T_{SG} : Speed governor time constant
- T_t : Turbine time constant
- f : Frequency of system
- f_{ref} : Reference frequency for system
- Δf : Change in system frequency
- X_{tie} : reactance of tie line

REFERENCES

1. Yao Zhang, Lili Dong, Zhiqiang Gao; "Load Frequency Control for Multiple-Area Power Systems", 2009 American Control Conference Hyatt Regency Riverfront, St. Louis, MO, USA June 10-12, 2009.
2. Nasser Jaleeli, Donald N. Ewart, Lester H. Fink; "Understanding automatic generation control", IEEE Transaction on power system, Vol. 7, No. 3, August 1992. Pages: 1106-1122.
3. G. V. Hicks, B. Jayasurya, P. Eng; "An investigation of automatic generation control for an isolated transmission system", IEEE Canadian Conference on Electrical and Computer Engineering, Vol. 2, May 1997. Pages: 31- 34.
4. Jyant Kumar, Kh- Hoi Ng, Gerald Shevle; "AGC simulator for price based operation", IEEE transaction in power system, Vol.12, No- 2, May 1997. Pages: 527- 532.
5. Jayant Kumar, Kh- Hoi Ng, Gerald Shevle; "AGC simulator for price based operation Part- 2", IEEE transaction in power system, Vol.12, No- 2, May 1997. Pages: 533- 538.
6. T. C. Yang, H. Cimen, Q.M. Zhu; "Decentralized load – frequency Controller design based on structured singular values", IEE proc. Gener, Transm, Distrib. Vol. 145 No. 1, January 1998.
7. Vaibhav Donde, M.A.Pai, and Ian A.Hiskens; "Simulation and Optimization in an AGC system after Deregulation", IEEE transactions on power systems, Vol.16, No -3, August 2001.
8. Li Pingkang Beijing and Ma Yongzhen; "Some New Concepts in Modern Automatic Generation Control Realization", IEEE 1998, pp1232-1236.
9. M.S. Anower, MR.I Sheikh, M.F. Hossain, M.G. Rabbani, A.B.M. Nasiruzzaman; "FUZZY GAIN SCHEDULING OF AN AGC IN A SINGLE AREA POWER SYSTEM", 4th International Conference on Electrical and Computer Engineering ICECE 2006, 19-21 December 2006, Dhaka, Bangladesh.
10. Zulfatman, M. F. Rahmat; "APPLICATION OF SELF-TUNING FUZZY PID CONTROLLER ON INDUSTRIAL HYDRAULIC ACTUATOR USING SYSTEM IDENTIFICATION APPROACH", International Journal On Smart Sensing And Intelligent Systems, VOL. 2, NO. 2, JUNE 2009.
11. Huang S. H, Chen Y. H. C. 2006. Adaptive Sliding Control with Self-Tuning Fuzzy Compensation for Vehicle Suspension Control. Mechatronics, Vol. 16: 607-622.
12. Loukianov A. G., Sanchez E., Lizarde C. 2007. Force Tracking Neural Block Control for an Electro-Hydraulic Actuator via Second-Order Sliding Mode. Int. Journal of Robust and Nonlinear Control, Wiley InterScience, 20, June : 319-332.
13. Q.P. Ha, H. Trinh. A Variable Structure- Based Controller with Fuzzy Tuning for Load Frequency Control, International Journal of Power and Energy Systems, Vol. 0, No.0, 2001.
14. Y.L. Karnavas, D.P. Papadopoulos, AGC for autonomous power system using combined intelligent techniques, Electric Power Systems Research 62 (2002), pp-225-239.



15. Shao J., Chen L., Sun Z. 2005. The Application of Fuzzy Control Strategy in Electro-hydraulic Servo System. In Proceedings of the IEEE International Conference on Mechatronics & Automation, 2010-2016. Niagara Falls, Canada.

AUTHORS PROFILE



Parveen Dabur received his B.E. degree in Electrical Engineering from M.D.U Rohtak, India in 2006, and received his M.E. degree in Electrical Engineering (Instrumentation & Control) from Deenbandu Chhotu Ram University of Science and Technology, Murthal, Sonapat (Haryana), India. His area of interest include power systems deregulation and optimal control of interconnected power systems, power system optimization & control.



Naresh Kumar Yadav received his M.Tech in Electrical Engineering from National Institute of Technology, Kurukshetra. He is presently working as Asst. Prof. in the Department of Electrical Engineering at Deenbandhu Chhotu Ram University of Science & Technology, Murthal (Sonapat), Haryana, INDIA. His research interests include power system deregulation, FACTS applications to power systems and custom power, optimal control of interconnected power systems, power system optimization & control.



Ram Avtar received his B. Tech in Electronics & comm from IETE Delhi. He is presently working in BSNL india. His research interest includes communication system, solid state devices & optimization techniques.