

Application of STATCOM and CROWBAR for Transient Stability Improvement and Performance Enhancement for A Wind Turbine Based Doubly Fed Induction Generator

CH.AppalaNarayana, D.V.N.Ananth, T. PapiNaidu, B. Santosh Kumar, S. Saikiran, I. Prasanna Kumar, Y.Naveen Kumar, K.V.Ramana

Abstract: This paper presents a robust control of Doubly Fed Induction Generator (DFIG) wind turbine in a sample power system. DFIG consists of a common induction generator with slip ring and a partial scale power electronic converter. Indirect field-oriented controller is applied to rotor side converter for active power control and voltage regulation of wind turbine. On grid side PQ control scheme is applied. Wind turbine and its control units are described in details and also for STATCOM control. All power system components are simulated in MATLAB/SIMULINK software. For studying the performance of controller, different abnormal conditions are applied even the worst case. Simulation results prove that the performance of STATCOM and DFIG control schemes as improving power quality and stability of wind turbine.

Keywords: STATCOM, PQ control theory, induction machine, PWM, crowbar, rotor side controller, grid side controller, DFIG, wind turbine.

I. INTRODUCTION

To have sustainable growth and social progress, it is necessary to meet the energy need by utilizing the renewable energy resources like wind, biomass, hydro, co-generation, etc. In sustainable energy system, energy conservation and the use of renewable source are the key paradigm. The need to integrate the renewable energy like wind energy into power system is to make it possible to minimize the environmental impact on conventional plant [1]. The integration of wind energy into existing power system presents a technical challenges and that requires consideration of voltage regulation, stability, power quality problems. The power quality is an essential customer-focused measure and is greatly affected by the operation of a distribution and transmission network. The issue of power quality is of great importance to the wind turbine [2].

Manuscript received on January, 2013.

CH.AppalaNarayana, VITAM College of Engineering, Visakhapatnam, India.

D.V.N.Ananth, VITAM College of Engineering, Visakhapatnam, India.

S. Saikiran, VITAM College of Engineering, Visakhapatnam, India.

I. Prasanna Kumar, VITAM College of Engineering, Visakhapatnam, India.

Y.Naveen Kumar, VITAM College of Engineering, Visakhapatnam, India.

K.V.Ramana VITAM College of Engineering, Visakhapatnam, India.

T. PapiNaidu, DADI Engineering Colleges.

B. Santosh Kumar, DADI Engineering Colleges.

There has been an extensive growth and quick development in the exploitation of wind energy in recent years. The individual units can be of large capacity up to 2 MW, feeding into distribution network, particularly with customers connected in close proximity [3]. Today, more than 28000 wind generating turbine plants are successfully operating all over the world [6, 9]. In the fixed-speed wind turbine operation, all the fluctuation in the wind speed are transmitted as fluctuations in the mechanical torque, electrical power on the grid and leads to large voltage fluctuations. During the normal operation, wind turbine produces a continuous variable output power. These power variations are mainly caused by the effect of turbulence, wind shear, and tower-shadow and of control system in the power system. There has to be a protection for such situations [4]. Thus, the network needs to manage for such fluctuations. The power quality issues can be viewed with respect to the wind generation, transmission and distribution network, such as voltage sag, swells, flickers [8], harmonics etc. However the wind generator introduces disturbances into the distribution network.

One of the simple methods of running a wind generating system is to use the induction generator connected directly to the grid system [5]. The proposed STATCOM control scheme for grid connected wind energy generation for power quality improvement has following objectives.

- Unity power factor at the source side.
- Reactive power support only from STATCOM to wind Generator and Load.
- Simple bang-bang controller for STATCOM to achieve fast dynamic response.

Shunt Flexible AC Transmission System (FACTS) devices, such as the Static Var Compensator (SVC) and the Static Synchronous Compensator (STATCOM), have been widely used to provide high performance steady state and transient voltage control at the Point of Common Coupling (PCC) [6]. The applications of a SVC or a STATCOM to fixed-speed wind turbines equipped with induction generators have been reported in [7] for steady state voltage regulation, and in [1] for short-term transient voltage stability.

Doubly fed induction generator (DFIG) is one of the most popular wind turbines which includes an induction generator with slip ring, a partial scale power electronic converter and a common DC-link capacitor. Power electronic converter which encompasses a back to back AC-DC-AC voltage source converter has two main parts; grid side converter (GSC) that rectifies grid voltage and rotor side converter (RSC) which feeds rotor circuit. Power converter only processes slip power therefore it's designed

The reference d-axis current, which is formed by PI controller and q-axis current, which set to zero are both transformed to abc reference frame using the Park's transformation inverse. The error signals issued from the comparison between current reference values and actual ones are applied to PWM controllers. The logical outputs of these controllers are the switching signals of power transistor in GSC to maintain the desired currents. The proposed scheme is shown in fig. 3.

The Grid side controller (GSC) controls the dc voltage V_{dc} and provides reactive power support. which is used to design the outer dc voltage control loop, where C_{dc} is the dc capacitance and I_{dc} and I_{load} are the dc currents on LSC and RSC side, respectively. A voltage-oriented cascade vector control structure with inner current control loops is applied. The line current I_l can be controlled by adjusting the voltage drop across the line inductance as shown in Fig4.

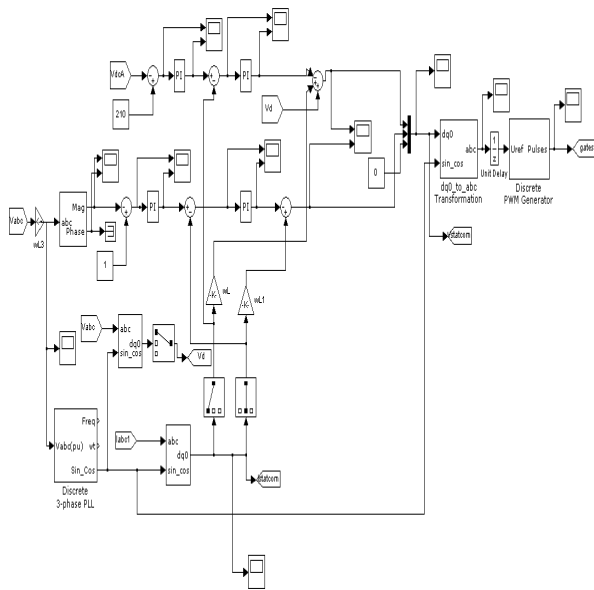


Fig 5. Control scheme for STATCOM

In its most basic form, the STATCOM configuration consists of a VSC, a dc energy storage device; a coupling transformer connected in shunt with the ac system, and associated control circuits. Fig.5, shows the basic configuration of STATCOM with wind turbine driven DFIG connected directly to the grid. The VSC converts the dc voltage across the storage device into a set of three-phase ac output voltages. These voltages are in phase and coupled with the ac system through the reactance of the coupling transformer. Suitable adjustment of the phase and magnitude of the STATCOM output voltages allows effective control of active and reactive power exchanges between the STATCOM and the ac system.

The VSC connected in shunt with the ac system provides a multifunctional topology which can be used for up to three quite distinct purposes:

- 1) Voltage regulation and compensation of reactive power
- 2) Correction of power factor
- 3) Elimination of current harmonics.

The design approach of the control system determines the priorities and functions developed in this analysis. In this paper, the STATCOM is used to regulate voltage at the point of connection. The control is based on discrete PWM and only requires the measurement of the rms voltage at the load point, reference voltage near the grid and dc voltage near the STATCOM VSC converter.

IV. DESIGN OF DFIG SYSTEM WITH RSC, GSC AND STATCOM

The wind energy generating system is connected with grid having normal and non-linear load. The performance of the system is measured by switching the STATCOM at time s in the system and how the STATCOM responds to the step change command for increase in additional load at 1.0s is shown in the simulation. When STATCOM controller is made ON, without change in any other load condition parameters, it starts to mitigate for reactive demand as well as harmonic current. The dynamic performance is also carried out by step change in a load, when applied at 1.0 s. This additional demand is fulfill by STATCOM compensator. Thus, STATCOM can regulate the available real power from source.

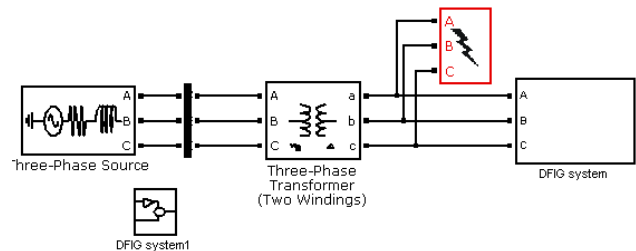


Fig 6a. Overall system design for wind turbine driven DFIG and STATCOM controller

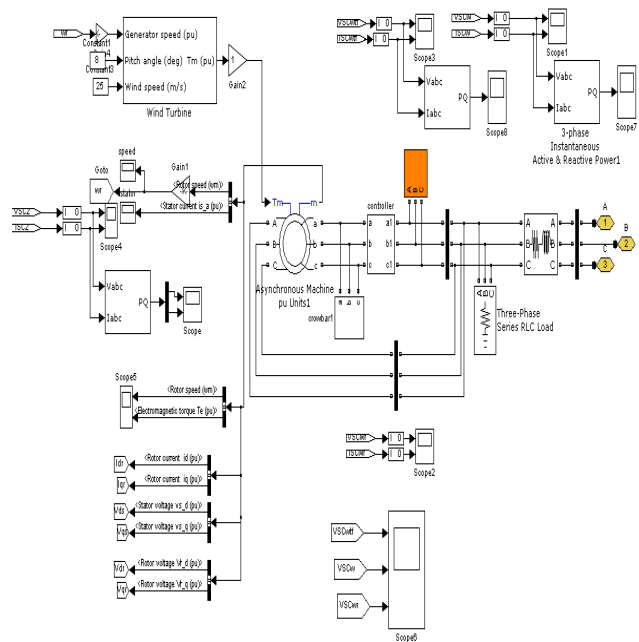


Fig 6b. Internal block diagram of DFIG, crowbar protection and STATCOM controller

V. UNINTERRUPTED OPERATION FEATURE OF THE WIND TURBINE DURING GRID FAULTS

The idea behind this feature is that the wind turbine does not trip when the when a severe symmetrical fault occurs near the grid or near the generator system. The wind turbine continues its operation with the induction generator (IG) with a short-circuited rotor circuit, such that the speed of the IG decreases. It may sometimes reach zero when a low impedance short circuit occurs. During such an operation condition, the self controllability of the IG is naturally lost and there is no longer any independent control of active and reactive power in the DFIG. The generator becomes a conventional induction generator, which produces an amount of active power and starts to absorb an amount of

Application of STATCOM and CROWBAR for Transient Stability Improvement and Performance Enhancement for A Wind Turbine Based Doubly Fed Induction Generator

reactive power. In order to prevent the wind turbine from over-speeding or under speeding, the pitch angle controller can be activated to keep the speed around the pre-defined value.

During such circumstances, the STATCOM control system continues monitoring the generator current, the terminal voltage, the active and reactive powers and the generator rotor speed. When the fault has cleared and when the terminal voltage and the rotor current return back to their pre-defined ranges, the STATCOM starts synchronization [1]. At synchronization, the STATCOM starts switching and the external resistance is disconnected; the d-q components of the STATCOM voltage source (Fig. 2) are set to $v_{dr} = i_{dr} \cdot R_{ext}$ and $v_{qr} = i_{qr} \cdot R_{ext}$, which are used by the PWM module to generate the IGBT gate control signals to drive the IGBT converter. When the synchronization seems to be complete, the control system of the STATCOM switches to the regular control system as shown in Fig. 3 and the STATCOM re-starts. When the STATCOM has re-started, the SCIG again has independent active and reactive power control and the wind turbine returns to normal operation.

The advantages of this uninterrupted operation feature include: (1) the wind turbine continues supplying the active power to the power network and therefore the demand for immediate power reserves does not exist or it is reduced; (2) the wind turbine can contribute to maintaining the frequency in the power network during a transient state.

The controllability of RSC, GSC and STATCOM are analyzed in deep in this work. The rotor current controller should only regulate the positive sequence component of the rotor currents. The severe voltage disturbance introduced by the derivative of the stator flux should be feed-forward compensated at the beginning and at the end of the fault, for a short duration, so that rotor current control can be maintained

In the case of a weak power network, there can be a risk of voltage instability initiated by the grid fault. As a result, the STATCOM will not re-start and the wind turbine will be disconnected from the network. But STATCOM is to be used as dynamic reactive compensator – to provide transient voltage support to help the wind turbine IG ride through grid faults. In addition, the STATCOM can also be used for steady state voltage regulation and power factor control of the SCIG.

VI. RESULT ANALYSIS

The system design is as shown in Fig 3. It is wind turbine driving induction machine as generator and STATCOM is connected near the midpoint of the system. In this analysis, there are three cases, first is without Grid Side Controller (GSC), Rotor Side Controller RSC and STATCOM and with symmetrical fault near PCC, and second is with without STATCOM, but with GSC and RSC having the same disturbance as in previous case and in third case, with GSC, RSC and with STATCOM with same three phase to ground fault occurring in the system. The system performances in all the cases are observed when a severe symmetrical short circuit occurs in the system with fault resistance of 0.1 ohms were considered.

Case 1: without GSC, RSC and STATCOM with three phases to ground fault at PCC

A symmetrical fault occurred at 0.1s and cleared at 0.15s for the system without GSC, RSC and STATCOM but with crowbar controller. The crowbar controller is designed with

hysteresis scheme, with variable current flow control by using a resistance and IGBT connected in series to each other and crowbar is connected in parallel and placed near the rotor of DFIG.

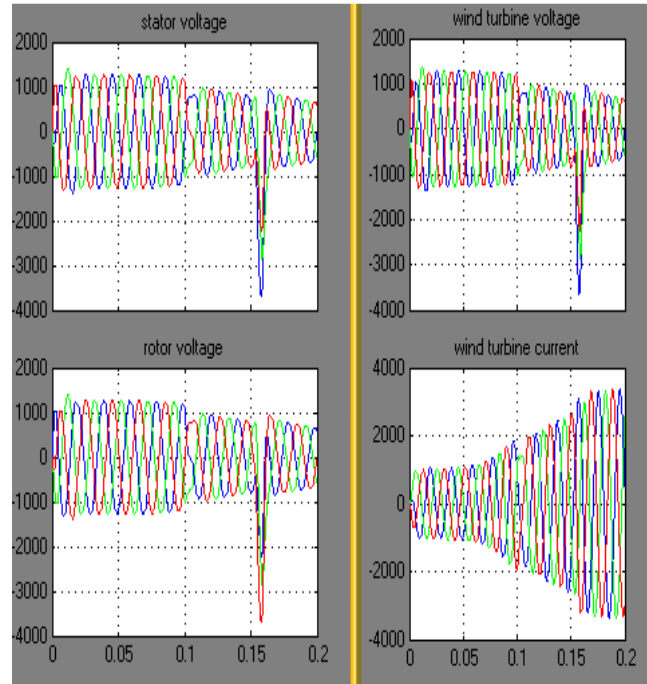


Fig 7. Without STATCOM (left side) and with STATCOM (right side) showing speed, torque and current waveforms in pu.

A 3phase to ground fault occurred near PCC at 0.1s and cleared at 0.15s is as shown in Fig 7. It can be observed that, the voltage and current slowly decreasing due to this disturbance. At the moment of fault clearance, a severe surge is produced and the output voltage of DFIG is decreasing and current is increasing.

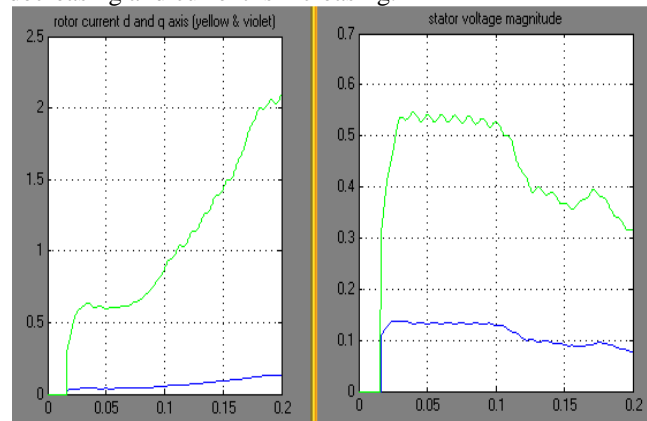


Fig 8. The d-q axis rotor current (left) and stator voltages (right)

The Fig 8 depicts that the direct and quadrature axis current of rotor and stator voltages are highly unstable and starts to violate their limits leading to severe unstable operation of the system

Case 2: with GSC, RSC and without STATCOM and with three phase to ground fault in the system

Although occurrence of three Ph-G faults is very low practically, such fault leads to destruction in system and system collapse. When a symmetrical fault occurs between 0.1s to 0.15s, the system results are verified without STATCOM but with GSC and RSC schemes. The control schemes are shown in Fig 3 and 4.

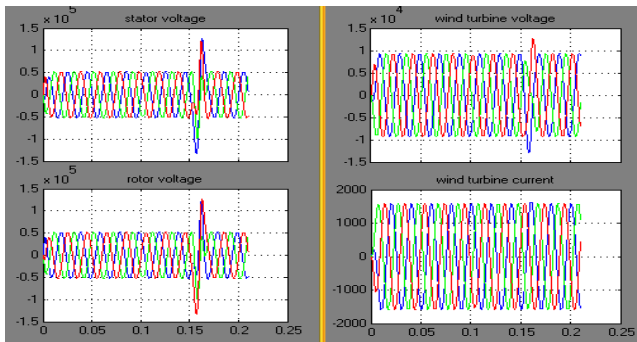


Fig 9. With GSC and RSC but without STACOM showing voltage and current waveforms i with a 3PHG fault between 0.1 to 0.15s

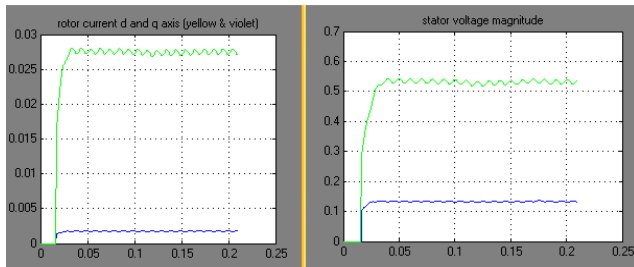


Fig 10. The d-q axis rotor current (left) and stator voltages (right) with GSC and RSC schemes

During this scenario, a three phase to ground fault with fault resistance of 0.1 ohms occurs between phases at 0.1seconds and cleared at 0.15s. The stator and rotor voltages and currents are nearly maintained before and after the fault in this case. In Fig 9, it can be observed that stator and rotor voltages and current are same at pre-fault and post fault, but there is a surge current produced after clearing of fault. In fig 10, direct and quadrature axis current of rotor and voltage of stator are nearly maintained constant, due to the absorption of fault current by RSC.

Case 3: with STATCOM and with three phase to ground fault in the system

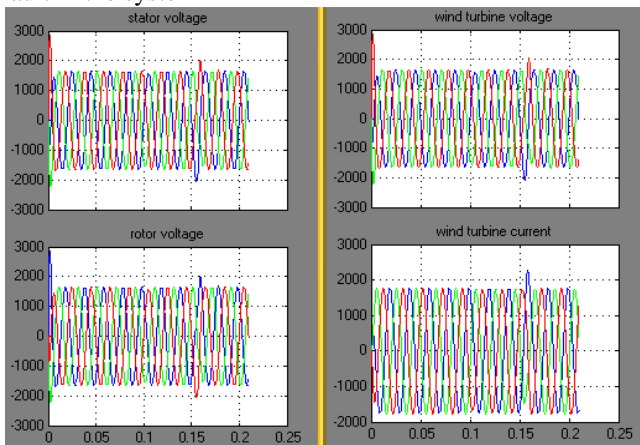


Fig 11. With GSC, RSC and STACOM showing voltage and current waveforms with a 3PHG fault between 0.1 to 0.15s

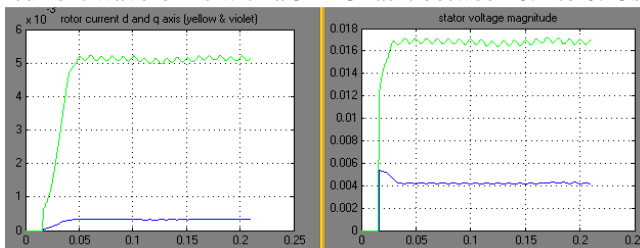


Fig 12. The d-q axis rotor current (left) and stator voltages (right) with GSC and RSC schemes

In this case as shown in Fig 11, the voltages and currents of stator and rotor are same at pre-fault, during and also at post fault conditions. The surge currents and voltages at stator side are also limited by the STATCOM. Hence overall system performance has improved by incorporating sophisticated RSC, GSC and STATCOM control schemes. The dq axis voltages and currents of stator and rotor are also maintained constant in this case. In this case, not only stability improved, reactive power generation has controlled and real power transfer has increased. The overall system power factor delivering to grid improved.

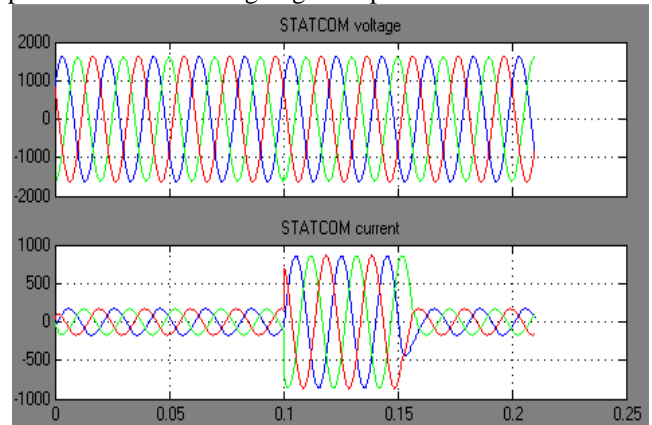


Fig13. Showing injected three phase voltage and current by STATCOM

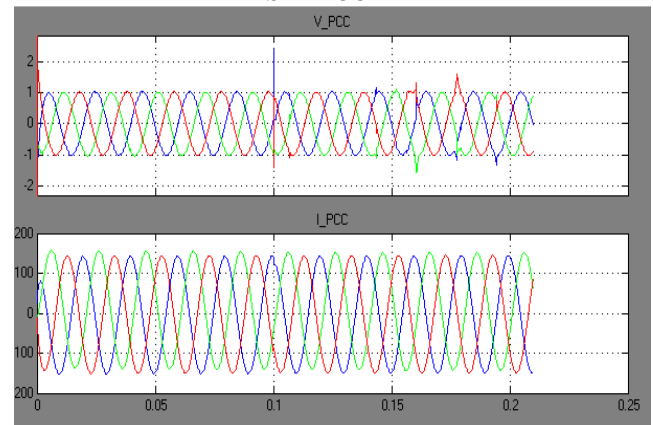


Fig15. Output voltage and current from wind turbine system reaching PCC

The system with GSC, RSC and STATCOM controller with a three phase to ground fault occurs between 0.1s to 0.15s are shown in figures 11 to 15. If comparing without and with STATCOM from Fig 9 and 11, the voltage and current ripples near stator has minimized. The excess short circuit current flowing through the rotor of DFIG is diverted through STATCOM by using dual flow voltage regulator control scheme. In fig 14, it can be observed that severe surge current is entering into STATCOM, charging the capacitor making it as lagging compensation. After fault clearance again, the voltage and current of STATCOM reached to its normal value, thereby changing its power factor again. Hence STATCOM is current injected VSC with power factor correction

VII. CONCLUSIONS

With a sophisticated controller for GSC, RSC and STATCOM, there can be high improvement in overall power system stability, reactive power flow, extraction of maximum power from DFIG, maintaining nearly constant voltage at PCC even after occurrence of severe symmetrical fault anywhere in the system. It is desired to protect the

Application of STATCOM and CROWBAR for Transient Stability Improvement and Performance Enhancement for A Wind Turbine Based Doubly Fed Induction Generator

system from surge currents and harmonics mitigation and flickering issues. It can also be observed that stability of system enhanced, reactive power flow has been controlled. The STATCOM based controller not only control current from stator and rotor or improves stability, it can mitigate both current and voltage harmonics occurring in the system..

VII. REFERENCES

- [1] A. Sannino, "Global power systems for sustainable development," in IEEE General Meeting, Denver, CO, Jun. 2004.
- [2] K.S Hook, Y. Liu, and S. Atcity, "Mitigation of the wind generation integration related power quality issues by energy storage," EPQU J., vol. XII, no. 2, 2006.
- [3] R. Billinton and Y. Gao, "Energy conversion system models for adequacy assessment of generating systems incorporating wind energy," IEEE Trans. on E. Conv., vol. 23, no. 1, pp. 163–169, 2008, Multistate.
- [4] D. Tziouvaras, "Relay Performance during Major System Disturbances," in Proc. Protective Relay Engineers, 2007. 60th Annual Conference, College Station, TX, 27-29 March 2007, pp. 251-270.
- [5] J. Manel, "Power electronic system for grid integration of renewable energy source: A survey," IEEE Trans. Ind. Electron., vol. 53, no. 4, pp. 1002–1014, 2006, Carrasco.
- [6] M. Tsili and S. Papathanassiou, "A review of grid code technology requirements for wind turbine," Proc. IET Renew.power gen., vol. 3, pp. 308–332, 2009.
- [7] S. Heier, Grid Integration of Wind Energy Conversions. Hoboken, NJ: Wiley, 2007, pp. 256–259.
- [8] J. J. Gutierrez, J. Ruiz, L. Leturiondo, and A. Lazkano, "Flicker measurement system for wind turbine certification," IEEE Trans. InstrumMeas., vol. 58, no. 2, pp. 375–382, Feb. 2009.
- [9] Indian Wind Grid Code Draft report on, Jul. 2009, pp. 15–18, C-NET.
- [10] P. Kundur, Power System Stability and Control, McGraw Hill, 1994.
- [11] Charles Mozina, "Power Plant Protection and Control Strategies for Blackout Avoidance," in Proc. IEEE PES Advanced Metering, Protection, Control, Communication, and Distributed Resources Conference, March 14-17, 2006, pp. 200-218.
- [12] W. Elmore, Protective Relaying Theory and Applications, CRC Press, 2nd Edition, 2004.
- [13] Holdsworth, L., X.G. Wu, J.B. Ekanayake and N. Jenkins, 2003. Comparison of fixed speed and doubly-fed induction wind turbines during power system disturbances. IEE Proc. Gener. Transm. Distrib., 150 (3): 343-352.
- [14] W. Zhang, P. Zhou, and Y. He, "Analysis of the by-pass resistance of an active crowbar for doubly-fed induction generator based wind turbines under grid faults," in Proc. Int. Conf. Electr. Mach. Syst. (ICEMS), Oct., 2008, pp. 2316–2321.
- [15] G. Pannell, D. Atkinson, and B. Zahawi, "Minimum-threshold crowbar for a fault-ride-through grid-code-compliant dfig wind turbine," IEEE Trans. Energy Convers., vol. 25, no. 3, pp. 750–759, Sep. 2010.
- [16] J. Morren and S. de Haan, "Short-circuit current of wind turbines with doubly fed induction generator," IEEE Trans. Energy Convers., vol. 22, no. 1, pp. 174–180, Mar. 2007.
- [17] J. Yang, J. Fletcher, and J. O'Reilly, "A series-dynamic-resistor-based converter protection scheme for doubly-fed induction generator during various fault conditions," IEEE Trans. Energy Convers., vol. 25, no. 2, pp. 422–432, Jun. 2010.
- [18] A. Causebrook, D. Atkinson, and A. Jack, "Fault ride-through of large wind farms using series dynamic braking resistors (march 2007)," IEEE Trans. Power Syst., vol. 22, no. 3, pp. 966–975, Aug. 2007.
- [19] P. Flannery and G. Venkataramanan, "Unbalanced voltage sag ride-through of a doubly fed induction generator wind turbine with series grid-side converter," IEEE Trans. Ind. Appl., vol. 45, no. 5, pp. 1879–1887, Sep./Oct. 2009.
- [20] J. Liang, W. Qiao, and R. Harley, "Direct transient control of wind turbine driven dfig for low voltage ride-through," in Proc. IEEE Power Electron. Mach. Wind Appl. (PEMWA), Jun. 2009, pp. 1–7.

CH.Appala Narayana is doing his MTECH in power systems from VITAM College of Engineering, Visakhapatnam. His interested topics are renewable resources, FACTS controller.

D.V.N. Ananth received B.Tech Electrical Engineering from Raghu Engineering College, Visakhapatnam and M.Tech from Sreenidhi Institute

of Science & Technology, Hyderabad, India. He is working as an Assistant Professor in VITAM College of Engineering in Electrical Department. His favorite topics include Renewable electrical systems, industrial drives, power systems, power electronics, control systems, HVDC systems and Reactive power compensation techniques. He can be contacted by +91-8500265310

B.Santosh Kumar is an 2nd year MTech student from DADI Engineering College in Power electronics and drives branch of engineering. His favorite topics are Control systems, electrical measurements and instrumentation and digital control systems.

T.Papinaidu is an 2nd year MTech student from DADI Engineering College in Power electronics and drives branch of engineering. Before joining here as student, he worked for TandraPaparayidu college of Engineering near Tekkali, Visakhapatnam. He has more than 5 years of teaching experience. His favorite topics are Power Electronics, Industrial drives, Machine Design, Electrical Machines.

S.Sai Kiran completed MTech from GITAM Engineering College in 2010 and serving VITAM College of Engineering since then. His interesting topics include, Power Semi-conductor Drives, Power systems and control systems.

I. Prasanna Kumar has completed MTech from GITAM Engineering College in 2010 in power systems. His interesting topics include power system analysis, power systems operation and control.

Y.Naveen Kumar received his MTech from IIT Kharagpur, in 2009 and now working as Assistant Prof in EEE Department of VITAM College of Engineering. His favorite topics are linear digital integrated circuits, Dc machines, reliability in power systems and artificial intelligence

K.V.Ramana is doing final year MTech in VITAM College of Engineering in power systems. His favorite topics are machine design, field theory, signals and systems etc.